

ملاحظات

رضا نتائج الاختبارات

تعليمات المهندس الاستشاري :

موافق ☒ غير موافق ☐

التوقيع :

تم الاستلام : مندوب المقاول : التاريخ : / /



مكتب رمك للاستشارات الهندسية
Office Ramak For Engineering Consultancy
تصميم - إشراف - تخطيط عمراني - إدارة مشاريع

للإتصال: مدير المشاريع: 0842714799 الفاكس: 065517166
info@ramakwp371.com

جودة
أمانة



شركة طرق الرياض للمقاولات
RIVADIH ROADS CONTRACTING CO.

الاستشاري :- مكتب رمك للإستشارات الهندسية		الإدارة العامة للتنفيذ والإشراف		شركة طرق الرياض للمقاولات	
تقرير إستلام طبقة ردم					
PED-B/1-03		رقم الشارع :-		تلال الغروب	
2146		طول الشارع :-		BLOCK11	
10.00		عرض الشارع :-		BOUTTOM OF SUPGRADE	
		WIDHT-R 5.000		BUTTOM SGL	
		WIDHT-L 5.000			
PVI	Station	Easting	Northing	R	
L				C.L	CL width from L
SLOPE					CL width from R
10	0+112.50	528797.640	2370139.935	-5.000	5.000
11	0+125.00	528809.167	2370135.099	51.267	5.000
12	0+137.50	528820.693	2370130.262	51.173	5.000
13	0+150.00	528832.219	2370125.425	51.085	5.000
14	0+162.50	528843.746	2370120.589	51.002	5.000
15	0+175.00	528855.272	2370115.752	50.922	5.000
16	0+187.50	528866.798	2370110.916	50.842	5.000
17	0+200.00	528878.325	2370106.079	50.762	5.000
18	0+212.50	528889.851	2370101.243	50.682	5.000
19	0+214.60	528891.373	2370100.604	50.603	5.000
				50.592	5.000
الإستشاري				50.580	5.000
مكتب رمك للإستشارات الهندسية				50.560	5.000
الإسم :-				50.592	5.000
التوقيع :-				50.592	5.000
التاريخ :-				50.592	5.000
شركة طرق الرياض للمقاولات				50.592	5.000
الإسم :-				50.592	5.000
التوقيع :-				50.592	5.000
التاريخ :-				50.592	5.000

In-place Density and Water Content of Soil by EDG

Project	تنفيذ اعمال البنية التحتية	Report No.	PRO-240463.48
Client	شركة طرق الرياض للمقاولات	Testing Date	03/09/2024
Location	جدة - حي الامير فواز - مخطط تلال الغروب	Sample By	Sumon
Test Apparatus	WINTESTING EDG-WS	Ref.	ASTM D 7698

Layer	Bottom Sub Grade
Location	Block 11 Gardens Area No. 3 STA 0+100 to STA 0+214

FIELD TEST RESULTS						
TEST NO.	LOCATION	wet denisty	dry denisty	water content	compaction	percent req.
		kg/m3	kg/m3	%	%	%
1	0+115	2.269	2.112	7.4	96.4	
2	0+135	2.229	2.083	7.0	95.1	
3	0+160	2.299	2.127	8.1	97.1	
4	0+200	2.264	2.081	8.8	95.0	


M.D.D = 2.191 kg/m3
O.M.C = 7.52 %

The lab is responsible of all information provided in this report, unless this information is given by the client.


* These results are for the tested materials and tested locations only.

The lab is not responsible of sampling, sample is tested as received.


The report will not be re issued until authorized by the lab management. Lab is not responsible for the sample after the receipt of the test report.

Checked by




Approved by



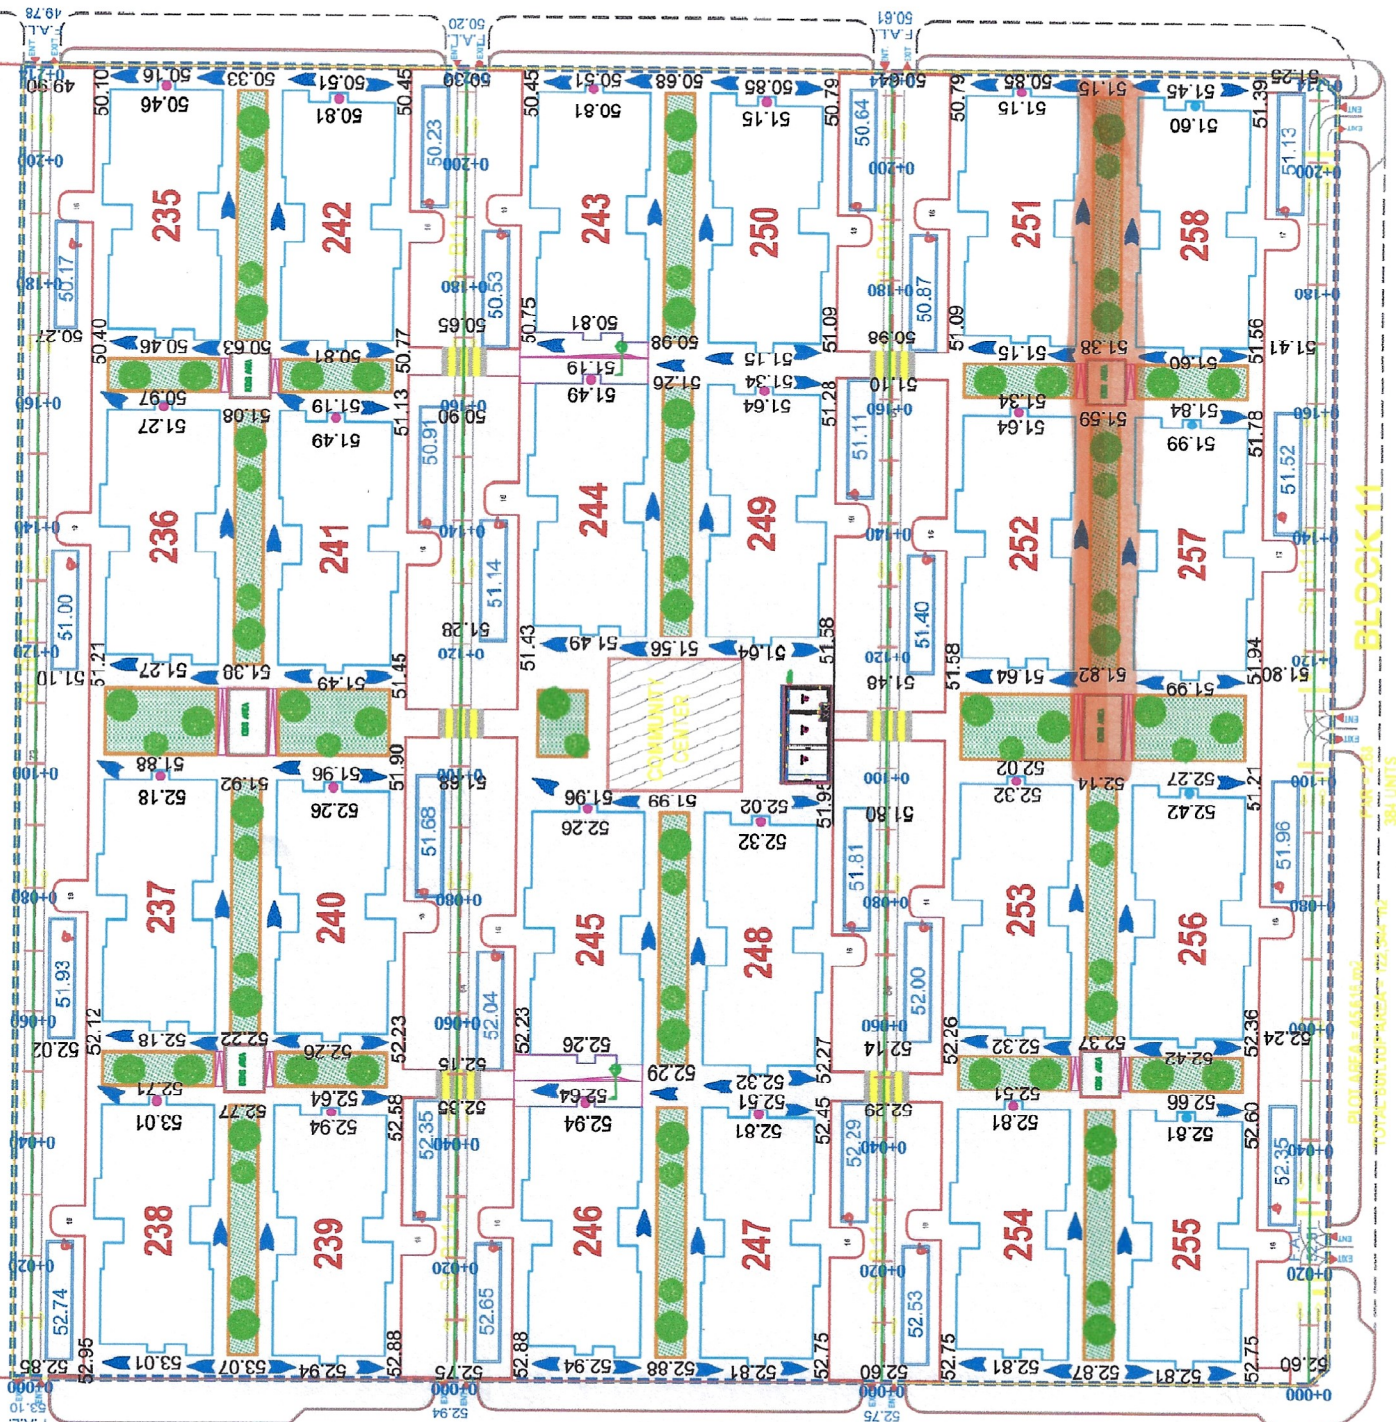


Block 11

384 UNITS

PLOT AREA = 45.616 m²

TOTAL BUILDUP AREA = 122,344 sq. ft.